



REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

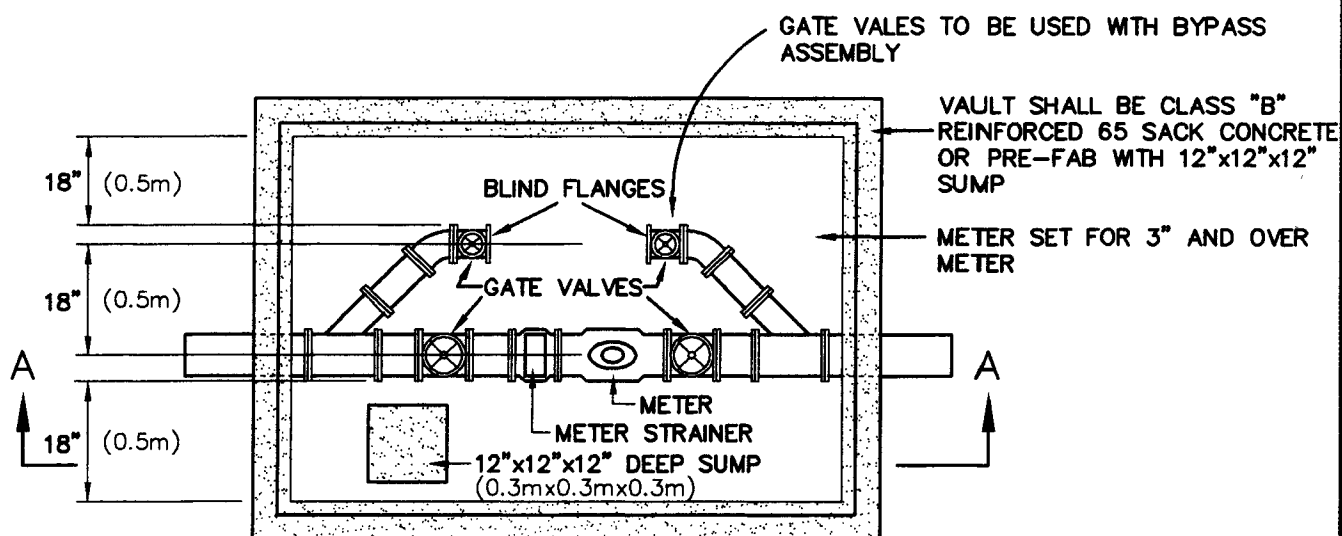

PLAN VIEW

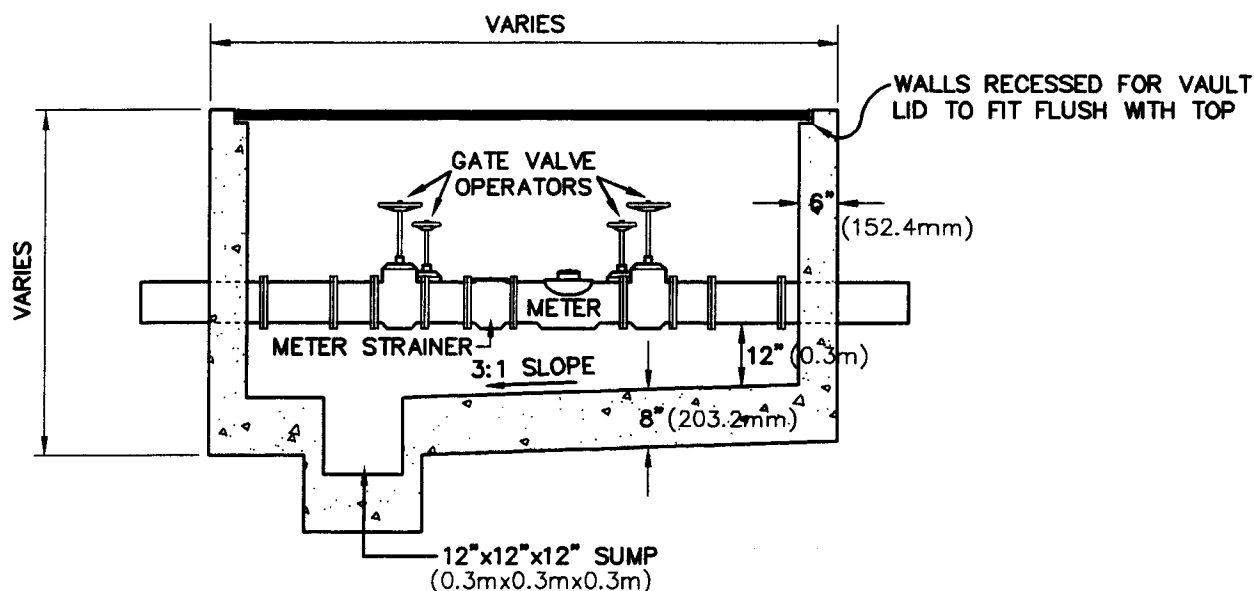

SECTION A-A

NOTE:

1. ALL METAL PIPING AND METAL APPURTENANCES TO BE COATED WITH RUST INHIBITOR (8 MILS MIN.) THICKNESS.
2. IF PRE-FAB VAULTS ARE USED, WALLS MAY BE 4" IN LIEU OF 6".
3. SEE STANDARD DRAWING G-12 FOR VAULT LID DETAILS.

DRAWN BY: C.A.C.	CITY OF PASO ROBLES ENGINEERING DIVISION	DRAWING NO.
DESIGNED BY:		
DATE: 4/18/94	METER BOX DETAILS FOR METERS LARGER THAN 2-INCH	G-11
FILE NAME: PR-G-11.DWG		